

APPLICATION

The ST795A Solid State Plug-in Timer provides the prepurge timing for the R7795 Primary Control. The ST795A is available with the following timings:


ST795 ORDER NUMBER	PREPURGE TIMING (sec)
A1007	1.5
A1015	7
A1023	10
A1031	30
A1049	60
A1056	90

INSTALLATION

Install the ST795A as follows:

1. Shut off the power to the R7795.
2. Remove the cover from the R7795.
3. Remove the current ST795A (if any) from the R7795 chassis by pulling the plastic support tab up and pulling the circuit board outward.
4. Make sure that the new ST795A selected has the desired timing period.
5. Insert the connector end of the ST795A into the slot in the R7795 chassis and clip the plastic support bracket over the timer board to secure it in place.
6. Reinstall the cover onto the R7795 and restore power to the device.

Run the burner system through at least one complete cycle to assure that the system is operating as desired.

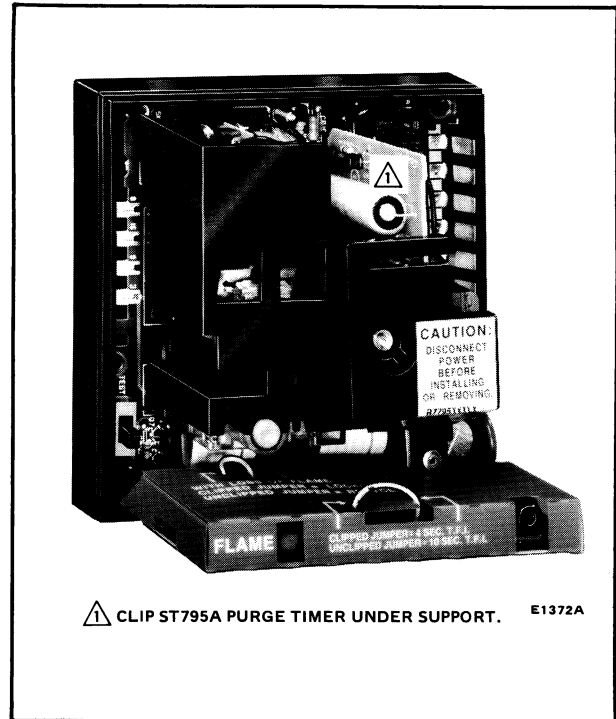

⚠ CLIP ST795A PURGE TIMER UNDER SUPPORT. E1372A