

Project Name: _____
 Location: _____
 Engineer: _____
 Submitted to: _____
 Submitted by: _____
 Reference: _____

Approval: _____
 Date: _____
 Construction: _____
 Unit #: _____
 Drawing #: _____

Performance

Indoor Unit Model No: FTXS24LVJU
 Outdoor Unit Model No: _____
 Rated Cooling Capacity (Btu/hr): 21000
 Sensible Capacity (Btu/hr): N/A
 Max/Min Cooling Capacity (Btu/hr / kW): databook/databook
 Cooling Input Power (kW): _____
 SEER: data book
 Rated Heating Capacity (Btu/hr): 25400
 Max/Min Heating Capacity (Btu/hr / kW): databook/databook
 Heating Input Power (kW): _____
 Heating COP (Btu/hr / Btu/hr): data book
 HSPF: data book

Indoor Unit Type: Mounted (Used only with RMXS48LVJU)
 Condensing Unit Type: _____
 Rated Cooling Conditions Indoor: 80°F DB/67°F WB
 Outdoor: 95°F DB/75°F WB
 Rated Heating Conditions Indoor: 70°F DB/60°F WB
 Outdoor: 47°F DB/43°F WB
 Rated Piping Length(ft) 25
 Rated Height Separation(ft) 0

Indoor Unit Details

Power Supply (V/Hz/Ph) 208-230/60/1ph
 Power Supply Connections: L1, L2, Ground
 Min Circuit Amps MCA (A): data book
 Max Overcurrent Amps MFA (A): data book
 Dimensions (HxWxD): 13-3/8x41-5/16x9-3/4
 Panel (HxWxD): N/A
 Net Weight (lbs): 31
 Weight with Panel (lbs): _____

Airflow Rate (CFM wet coil) 643/494/350/328
 Moisture Removal (pt/h): 1.2
 Gas Pipe Connection (inch): 5/8
 Liquid Pipe Connection (inch): 1/4
 Condensate Connection (inch): 5/8
 Sound Pressure Level (dBA): 51
 Sound Power Level (dBA): 67
 Static Pressure Rated/Max (inWg) 0 / 0/0

Condensing Unit Details

Power Supply (V/Hz/Ph): _____
 Power Supply Connections: L1, L2, Ground
 Min. Circuit Amps MCA (A): _____
 Max. Overcurrent Amps MFA (A): _____
 Max. Starting Current MSC(A): data book
 Rated Load Amps RLA (A): data book
 Dimensions (HxWxD): 30-5/16x35-7/16x12-5/8
 Net Weight (lbs): _____

Compressor Type: Inverter
 Capacity Control Range (%): _____
 Airflow Rate (CFM): N/A
 Gas Pipe Connection (inch): _____
 Liquid Pipe Connection (inch): _____
 Sound Pressure Level (dBA): _____
 Sound Power Level (dBA): _____

System Details

Refrigerant Type: R-410A
 Holding Refrigerant Charge (lbs): -
 Additional Charge (oz/ft): -
 Pre-charge Piping (Length ft): -
 Max. Pipe Length (Total ft): data book


Max. Pipe Length (Vertical ft): data book
 Cooling Operation Range (°F): 14 - 115
 Cooling Range w/Baffle (°F): _____
 Heating Operation Range (°F): 5 - 64
 Heating Range w/Baffle (°F): _____

Project Name: _____
 Location: _____
 Engineer: _____
 Submitted to: _____
 Submitted by: _____
 Reference: _____

Approval: _____
 Date: _____
 Construction: _____
 Unit #: _____
 Drawing #: _____

Dimensional Drawing - Indoor Unit

FTXS24LVJU

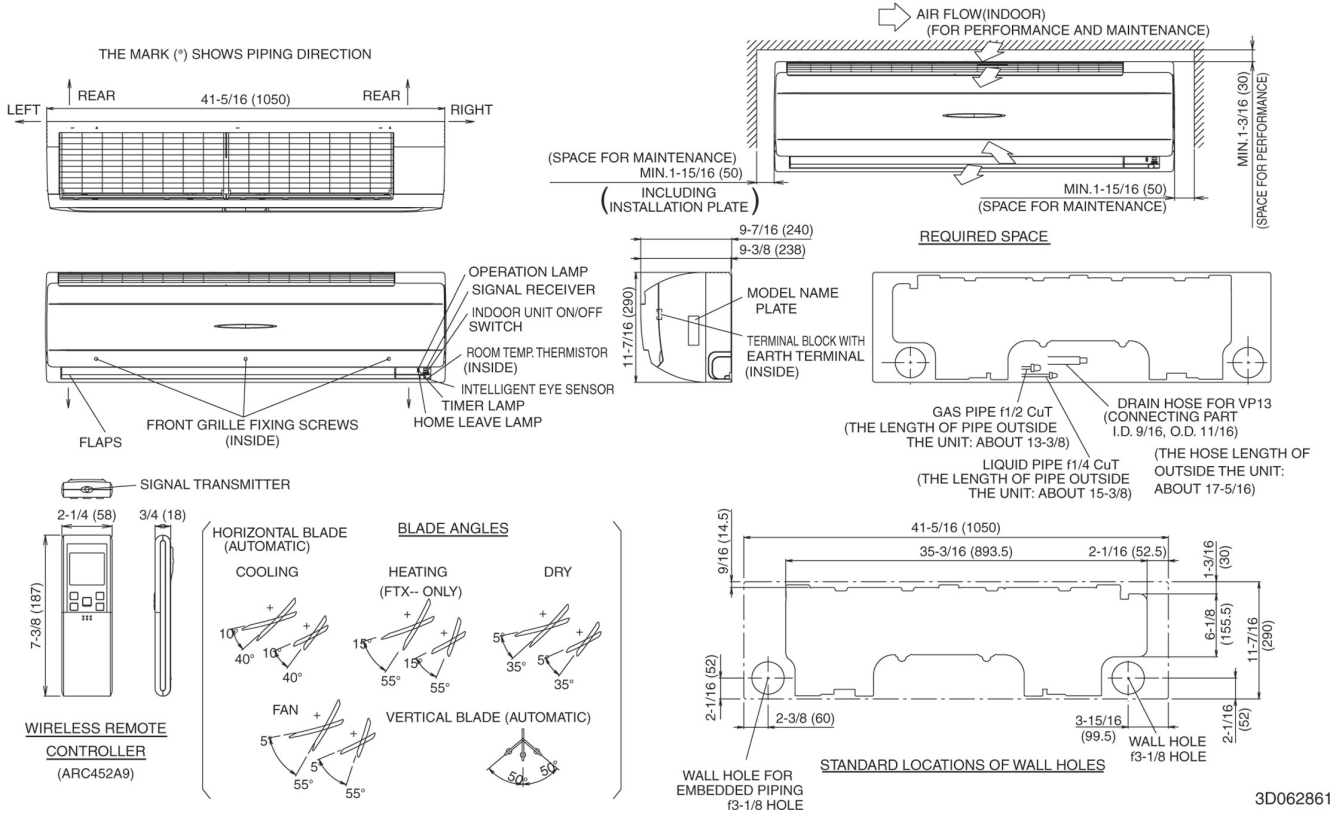

Project Name: _____
Location: _____
Engineer: _____
Submitted to: _____
Submitted by: _____
Reference: _____

Approval: _____
Date: _____
Construction: _____
Unit #: _____
Drawing #: _____

FTXS24LVJU



FTXS24LVJU

Std U.S. Warranty: 7yrs Compressor, 1yrs Parts

Std U.S. Warranty: 7yrs Compressor, 1yrs Parts